




Generation Deactivation Notification Update

Transmission Expansion Advisory
Committee

March 5th, 2024

Generation Deactivation Announcements 2020-2023

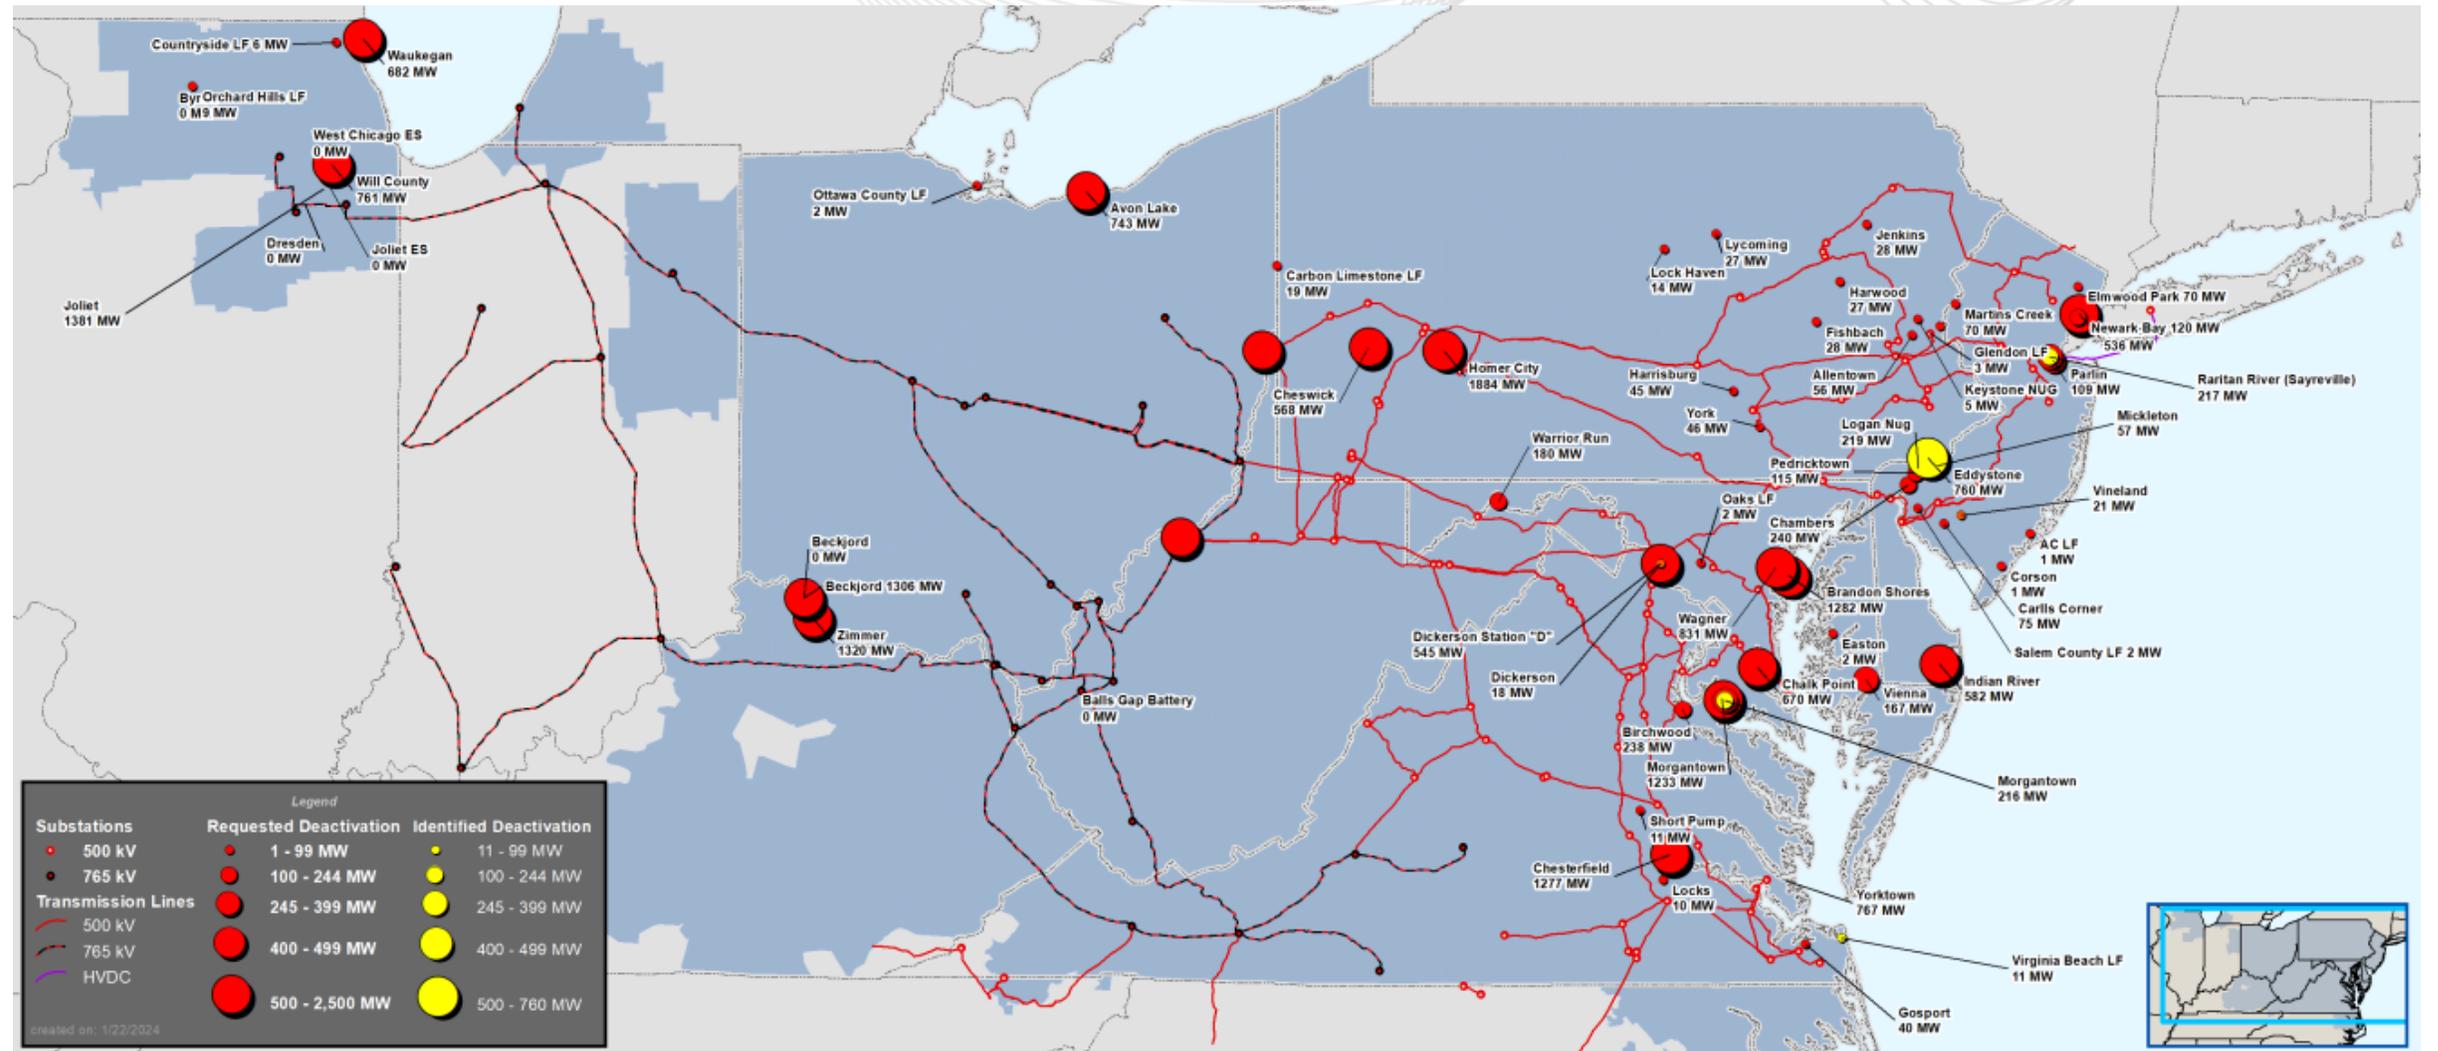



Q4 2023 Deactivation Status

Unit(s)	MW	Transmission Zone	Requested Deactivation Date	PJM Reliability Status
Virginia Beach 1 LF	11	DVP	04/01/2024	Reliability analysis completed. No impact identified.
Morgantown CT 3, 4, 5, 6	216	PEPCO	06/01/2024	Reliability analysis completed. No impact identified.
Sayreville Unit 1,2,3,4	217	JCPL	06/01/2024	Reliability analysis completed. No impact identified.
Eddystone Unit 3 & 4	760	PECO	05/31/2025	Reliability analysis completed. No impact identified.

* PJM does not approve deactivations, but rather identifies whether the requested deactivation date could lead to reliability concerns on the system. When PJM determines a proposed deactivation would adversely affect the reliability of the Transmission System due to upgrade completion timeline and absent operational measures, PJM desires and requests the Generation Owner extend operations of the deactivating unit(s). The Generation Owner may elect to support system reliability by operating until necessary network upgrades are completed by either filing its proposed Cost of Service Recovery Rate (CSRR) at FERC or accepting the Deactivation Avoidable Cost Credit (DACC) provided in the Tariff. PJM will announce at subsequent TEAC(s) after the Generation Owner submits a CSRR to the FERC and after the FERC accepts the CSRR filing or after the Generation Owner agrees to the DACC.

Facilitator:

Paul McGlynn, Paul.McGlynn@pjm.com

Secretary:

Tarik Bensala, Tarik.Bensala@pjm.com

SME:

Perry Ng,

PakKaiPerry.Ng@pjm.com

Generation Deactivation Notification



Member Hotline

(610) 666 – 8980

(866) 400 – 8980

custsvc@pjm.com



Revision History

V1 - 02/29/2024 - Original slides posted.